# SEM206TH - SMART THERMISTOR INPUT - TWO WIRE (4 to 20) mA OUTPUT TRANSMITTER USER MANUAL



# IMPORTANT - CE & SAFETY REQUIREMENTS

This product must be mounted inside an suitable enclosure providing environmental protection = > IP65.

To maintain CE compliance all input wires must be less than 3 metres.

The product contains no user serviceable parts, or internal adjustments. No attempt should be made to repair this device. Faulty units must be returned to supplier or manufacturer for repair or replacement.

This product must be installed by competent qualified personnel.

All electrical wiring must be installed to comply with the area standards, regulations.

Before attempting electrical connection ensure all supplies are switched off.

ABSOLUTE MAXIMUM OPERATING CONDITIONS:-

Supply + 100 mA (when supply exceeds 30 V dc protection device will conduct )

Supply Current on over voltage Input voltage ± 3.0 V

(-40 to 85) °C **Ambient** 



PLEASE REFER TO THE PRODUCT LABEL FOR MANUFACTURERS CONTACT DETAILS.

Every effort has been taken to ensure the accuracy of this document, however we do not accept responsibility for damage, injury, loss or expense resulting from errors and omissions, and we reserve the right of amendment without notice.

#### RECEIVE AND UNPACKING

Please inspect the packaging and instrument thoroughly for any signs of transit damage. If the instrument has been damaged, please notify your supplier immediately.

# SPECIFICATION (please refer to data sheet for full technical specification.)



# MECHANICAL INSTALLATION


#### MOUNTING
















The device is mounted using two 5.5 mm holes, on standard 33 mm fixing centres and will fit a DIN standard termination head. The device must be installed with adequate protection from moisture and corrosive atmospheres.

Care must be taken to ensure the device is located to ensure the ambient temperature does not exceed the specified operating temperature.




# **ELECTRICAL INSTALLATION**


### Wire sensor.

Sensor connections are as follows, to maintain BS EN61326 compliance sensor wires must be less than 3 metres. All sensor connections must be isolated from ground. Screened or twisted pair cable recommended for (4 to 20) mA loop.

### Thermistor



Wire (4 to 20) mA Loop




### PC SENSOR AND RANGE CONFIGURATION

USB Configuration Kit required to change sensor type.

This product is configured using the USB port of a PC running USBSpeedLink software, available from your supplier's web site. During configuration the product is powered direct from the usb port, removing the need for additional power. USBSpeedLink software is provided with detailed help menus to guide the user through the simple configuration procedure. Unless specified at the time of order this product is supplied with the default configuration listed below.


Connect red wire to + terminal, black wire to - terminal of the SEM206TH.

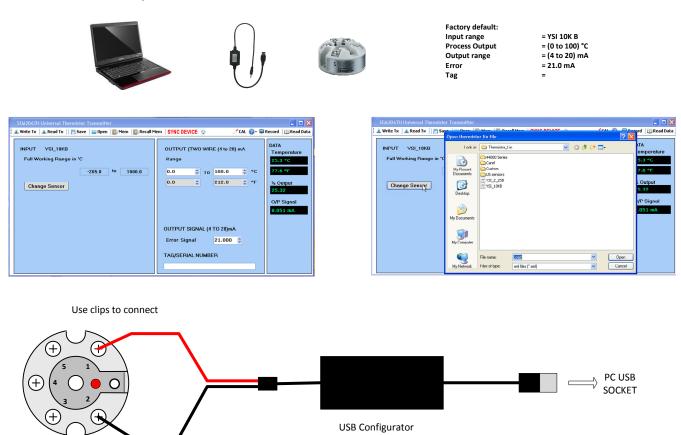

# MANUAL RANGE (ONLY) CONFIGURATION

Device to be configured

Equipment - Precision resistance box, DC power supply (voltage between (10 to 30) V dc), Screwdriver to operate push button and optional mA meter to monitor loop current.

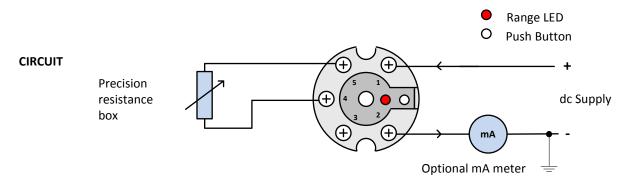

(Refer to thermistor tables for correct sensor resistance)

- 1. Connect the circuit as shown above, mA meter is optional.
- 2. Set the precision resistance box representative value for low scale (4 mA out) sensor resistance. Allow ten seconds settling time. (Refer to thermistor tables for correct sensor resistance)
- 3. Press and hold push button (for about five seconds) until the range led starts to flash. This indicates the new low range setting has been stored.
- 4. Set the precision resistance box representative value for high scale (20 mA out) sensor resistance.
- 5. Press and release push button to store new high range setting. The Range led will flash at a faster rate to indicate storing new value.
- 6. Device returns to normal operation.